


Spray & Preparation Conversions



AHP to be located to
Avoid Steelwork
Where Possible

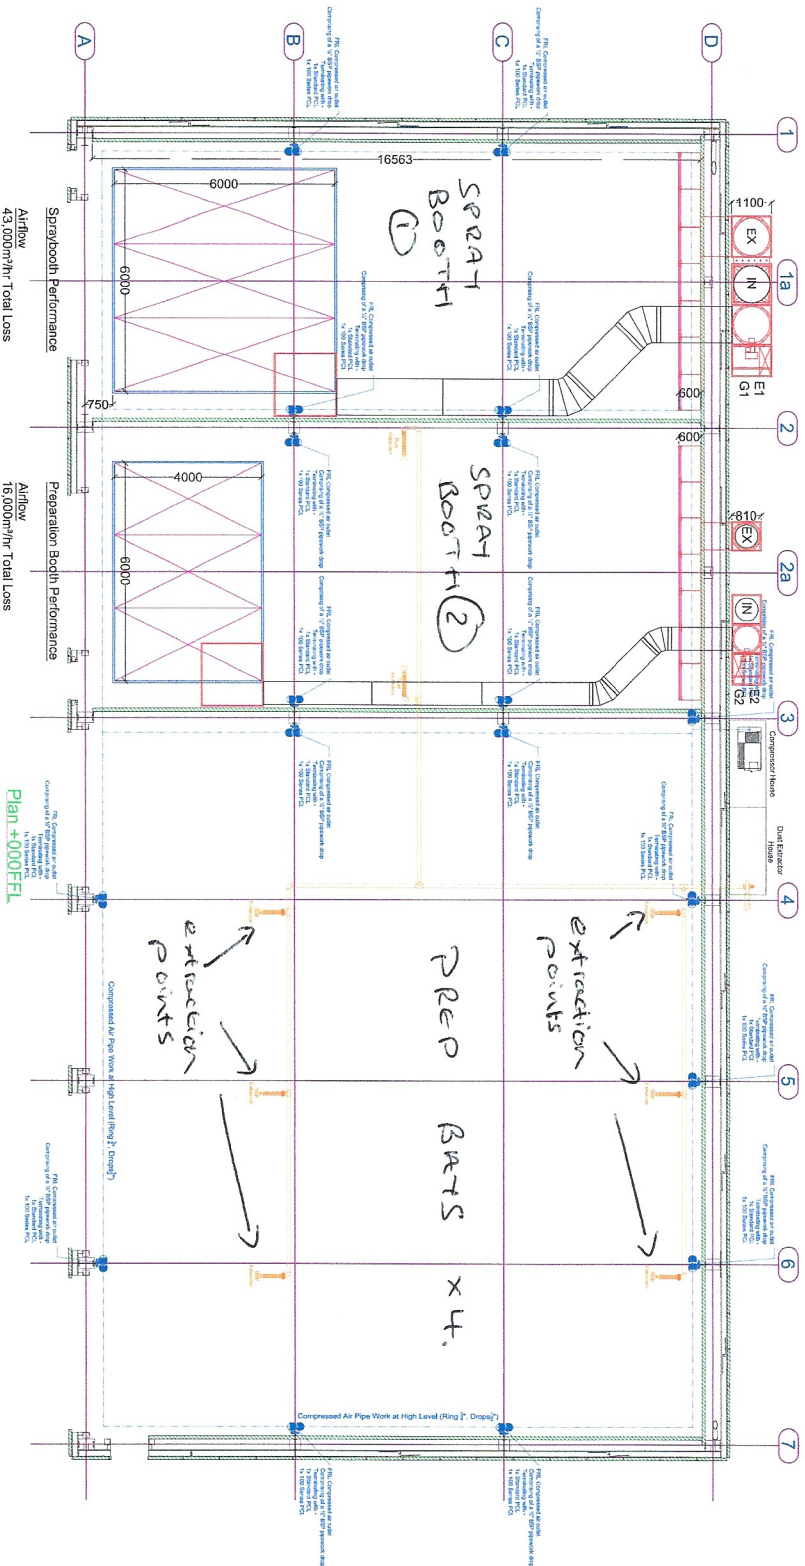

Spraybooth Performance
Airflow
43,000m³/hr Total Loss
2 of 13.2kW Axial Fans
1 Temperatures
1 of 28kW Gas Burner
Spray Cycle - 25°C Rise over
Ambient
Bake Cycle - 80°C

Preparation Booth Performance
Airflow
16,500m³/hr Total Loss
2 of 3.6kW Axial Fans
1 Temperatures
1 of 12kW Gas Burner
Spray Cycle - 25°C Rise over
Ambient

Plan +000FEL

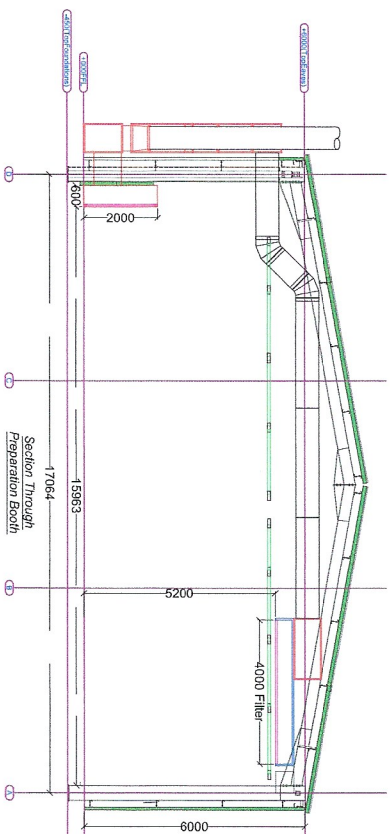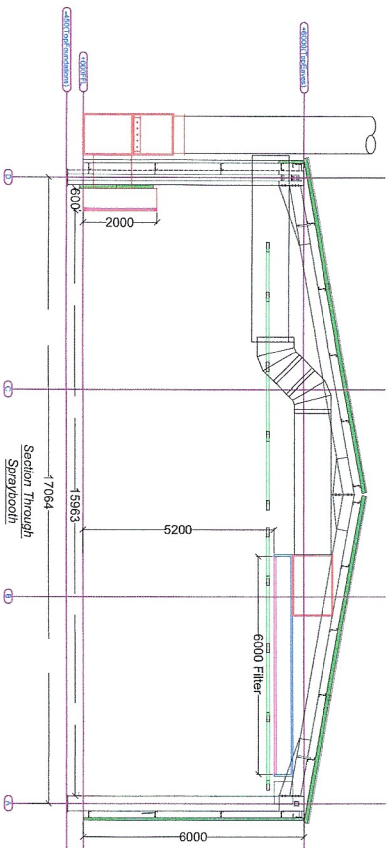

Notes:

This drawing is confidential communication and is the property of S.Catterall Ltd and is returnable or to be deleted on request. It is not to be copied, loaned or distributed without prior consent of S.Catterall Ltd. The live version is the electronic copy held at S.Catterall Ltd. Confirmation should be sought that request number is the latest and no date pending notices to allow for continuous development and updates. No claims are expressed or implied as to the safety, accuracy and usefulness of the information. S.Catterall Ltd standard terms and conditions of sale apply to any subsequent iterations.

S.Catterall Limited
Workshop Design & Installation

Bell Cottage, Hall Lane, Aspull, Wigan, WN2 2SH
Telephone: 01942 526 124
© 2018 S.Catterall Limited

Spray & Preparation Conversions
Chereau Stoke
Stoke

Representative	Drawn by	Scale
Steve Catterall	CS	1/20th November 2021
1:50	Page size for A3 (297 x 420mm)	Drawing Number SC 1026.3